Willibrord Lösing Filterproduktion GmbH

SEPAR FILTER

Distributed By: Separ of the Americas, LLC 4001 SW 47th Ave, Suite 201 Davie, FL 33314 USA Ph: (954) 523-9396

W. Lösing Filterproduktion GmbH • Am Walzwerk 2 • 45527 Hattingen

HFP


Manual Priming Pump




Technical Datasheet

The Manual Priming Pump is used in a fuel circuit to bleed the upstream fuel filter or to completely bleed the fuel circuit. It is installed downstream of the fuel filter.

Mechanical data

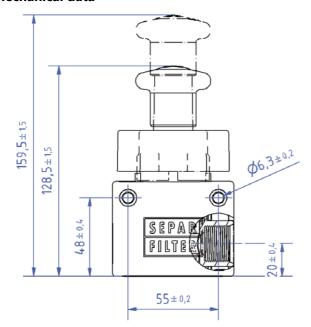



| | 2=2 |
|------|---------------|
| Mass | approx. 250 g |

Ambient temperature range

Flow-through operation $-40 \,^{\circ}\text{C}$ to 85 $^{\circ}\text{C}$ Pump operation $-20 \,^{\circ}\text{C}$ to 85 $^{\circ}\text{C}$

Fixing points 2
Threaded bolts M6

Tightening torque 6 Nm ±1 Nm

Media connectors 2

Threaded holes M22x1.5, compatible

with screw-in spigots according to ISO 6149-3,

Form F

Thread length can be screwed in \leq 18 mm

Tightening torque 12 Nm \pm 2 Nm

Nominal width 11 mm

Permissible system pressure

 $\begin{array}{ll} \text{permanent} & \leq 3 \text{ bar} \\ \text{momentary (<15 s)} & \leq 5 \text{ bar} \\ \text{Pump actuation} & \text{Ram} \end{array}$

Stroke approx. 30 mm

Suction height ≤5 m

Delivery volume ≤20 ml per stroke

Breakaway force ≤200 N
Pumping force ≤100 N
Destroying force >500 N

Performance data

Performance data items are limit values. By the integration into an existing infrastructure, the indicated performance data can be limited under certain circumstances.

Media (Please ask for media not listed.)


Diesel/Biodiesel according to EN 590
Fuel oil according to
DIN V 51603-6

Volume flow

Flow-through operation ≤10 l/min
Pressure loss insignificant



Mechanical connections

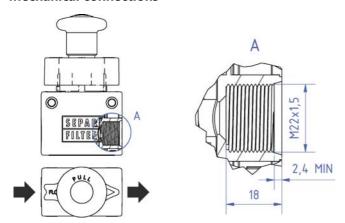


Mounting

The funktion of the Manual Priming Pump is independent of its mounting position. It must be fixed to a non-movable surface with two M6 threaded screws.

The following must be observed during installation:


- 1. The operating elements must be freely accessible.
- 2. Only straight pipe sections or pipe bends may be used as fuel pipes.
- 3. Mount in correct flow direction (arrow).
- 4. It must be possible to operate the shut-off valve and pump without risk of injury.

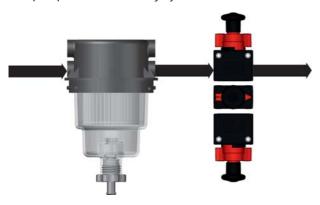


Application


1. Stop fuel flow, then close shut-off valve






2. Suction






3. Pump





4. Open shut-off valve, then start fuel flow





Distributed By: Separ of the Americas, LLC Ph: (954) 523-9396 www.separfilter.com contact@separfilter.com